



---

## CERTIFICATE OF APPROVAL

### No CF 5292

---

This is to certify that, in accordance with  
TS00 General Requirements for Certification of Fire Protection Products  
The undermentioned products of

## ALLEGION (UK) LIMITED

35 Rocky Lane, Aston, Birmingham, B6 5RQ, United Kingdom  
Tel: 0121 380 2400

Have been assessed against the requirements of the Technical Schedule(s)  
denoted below and are approved for use subject to the conditions  
appended hereto:

---

#### CERTIFIED PRODUCT

Briton 2420.T Series & BOSS  
ITS6.24 Series Concealed  
door closers

#### TECHNICAL SCHEDULE

TS 34 - The Contribution of  
Controlled Door Closing  
Devices and Accessories to  
Fire Resisting Doorsets

Signed and sealed for and on behalf of Warringtonfire Testing and Certification Limited

Paul Duggan  
Certification Manager

Issued: 14<sup>th</sup> January 2015  
Revised: 8<sup>th</sup> December 2025  
Valid to: 19<sup>th</sup> February 2030



## CERTIFICATE No CF 5292 ALLEGION (UK) LIMITED

- This certification is provided to the client for its own purposes, and we cannot opine on whether it will be accepted by Building Control authorities or any other third parties for any purpose.
- This approval relates to the following concealed overhead door closing device and configurations:

	BRITON		BOSS	
	2420.T	2420.T.EHO	ITS6.24	ITS6.24SA-EMF*
Single-action	✓	✓	✓	✓
Double-action	✗	✗	✗	✗
Body door mounted in top edge	✓	✓	✓	✓
Body transom mounted	✗	✗	✗	✗

**Key:** ✓ - approved      ✗ - Not approved

\*The ITS6.24SA-EMF refers to an Electro Hold Open track that is used in conjunction with the ITS6.24 closer body.

Note: Where alternative arms for non-fire applications are included within the packaging, the use of these components on fire resisting door assemblies will invalidate the certification.

- This approval relates to its use with the following door assemblies: -

**Code ITT - 20 minute to 60 minute door assemblies door assemblies incorporating intumescent perimeter seals and consisting of timber faced and edged leaves with timber or cellulosic cores, hung in timber or cellulosic frames.**

**Code ITT - 90 minute door assemblies door assemblies incorporating intumescent perimeter seals and consisting of timber faced and edged leaves with mineral cores, hung in mineral cored, timber faced frames.**

- The closer is approved on the basis of:

- Initial type testing to BS EN 1154, EN1155 and BS EN 1634-1
- An appraisal against TS34
- Certification of quality management system.
- Inspection and surveillance of factory production control
- On-going audit testing in accordance with EN 1154 and EN1155 requirements

- This approval relates to the use of the above closers in contributing to the fire resistance performance of timber based doorsets, as defined in BS EN 1634-1:2014+A1:2018 or BS 476-22: 1987.



---


## CERTIFICATE No CF 5292

### ALLEGION (UK) LIMITED


---

6. This approval is applicable only to the specified closer when mounted with its body concealed within the door leaf and its guide arm channel mounted to the head of the door frame, when fitted with the specified intumescent protection kit and used with door assemblies that are CERTIFIRE approved or have achieved the appropriate fire resistance performance when tested at a laboratory accredited to IS/IEC 17025 (under International Laboratory accreditation Cooperation (ILAC) membership), in accordance with BS 476: Part 22: 1987 and/or BS EN 1634:1 and having power ratings appropriate to the leaf sizes subject to a minimum size 3 (as specified in BS EN 1154).
7. Where the closers are fitted to door leaves or frames that are manufactured from mineral composite-based materials, or low-density cellulosic- based material, the door assembly shall have previously been shown capable of accommodating the installation of closers at the head of the doorset, without detriment to the door assembly's performance.
8. Concealed closers shall only be fitted to doorsets which have previously been shown capable of accommodating the installation of similar concealed items at the head of the doorset, without detriment to the doorset's performance.
9. The critical aspects of the doorset construction are considered to be the material of the door frame, the leaf to frame clearance gaps and the lipping material. Attention should be paid to these details, and these should not be amended from that previously fire tested.
10. This approval relates to Briton 2420.T & BOSS ITS6.24 concealed overhead closers Incorporating 440 mm x 23 mm wide x 15 mm deep mechanical guiderail with lever arm used with latched or unlatched single-leaf or double-leaf, assemblies consisting of timber faced and edged leaves with timber, cellulosic cores in timber frames (30 and 60 minutes) or mineral cores in mineral frames (90 minutes) and:
  - a. The bodies mounted in the door leaf, are approved for up to 30 minute single-action doorsets of the following specification (Code ITT):
    - i. Door leaves shall not be less than 44 mm thick.
    - ii. The door frame shall consist of softwood or hardwood with a minimum density of 450 kg/m<sup>3</sup> and with a minimum thickness of 30 mm (excluding any stop).
    - iii. The closer shall be fitted with intumescent protection in the form of a minimum of:
      - 2 mm thickness of Interdens mono ammonium phosphate sheet material, fully lining the mortices cut into the top edge of the door leaf to accommodate the closer body assembly and fully lining the mortices cut into the frame head member to accommodate the guide channel assembly.
      - Allegion (UK) Ltd provides an intumescent protection kit referenced 2420.IP.

## CERTIFICATE No CF 5292 ALLEGION (UK) LIMITED

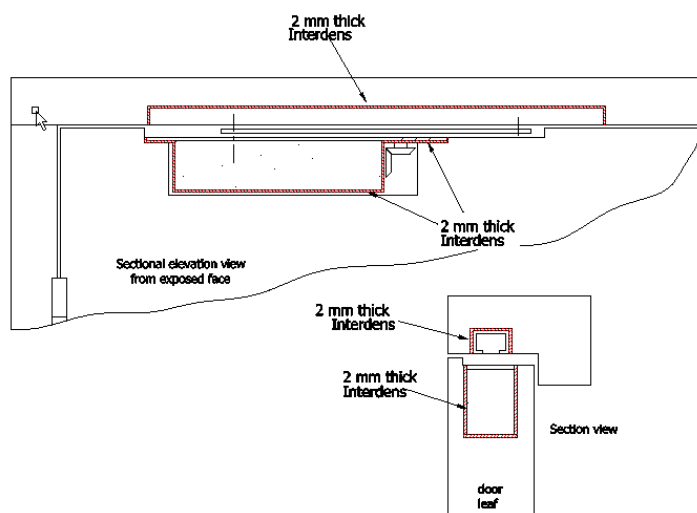


- b. The bodies mounted in the door leaf, are approved for 60 minute single-action doorsets of the following specification (Code ITT):
- Door leaves shall not be less than 54 mm thick.
  - The door frame shall consist of hardwood with a minimum density of 640 kg/m<sup>3</sup> and with a minimum thickness of 37 mm (excluding any stop).
  - The closer shall be fitted with intumescent protection in the form of a minimum of:
    - 2 mm thickness of mono ammonium phosphate sheet material, fully lining the mortices cut into the top edge of the door leaf to accommodate the closer body assembly and fully lining the mortices cut into the frame head member to accommodate the guide channel assembly.
    - Allegion (UK) Ltd provides an intumescent protection kit referenced 2420.IP.
  - In addition to the perimeter intumescent fire seals within the frame shall by-pass the guide rail by a minimum of 5.5 mm on each side.

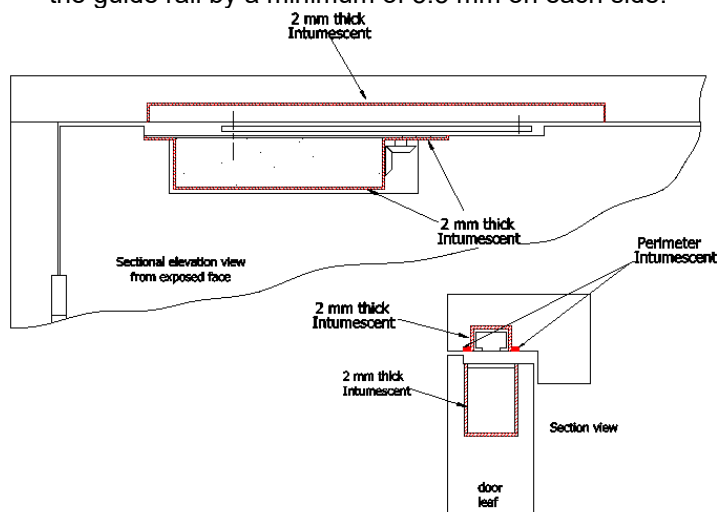

## CERTIFICATE No CF 5292 ALLEGION (UK) LIMITED

- c. The bodies mounted in the door leaf, are approved for 90 minute single-action doorsets of the following specification (Code ITT):
- Door leaves shall have a mineral core with a minimum leaf thickness of 58 mm.
  - The door frame shall be a mineral cored construction having minimum (core) section sizes of 90 mm deep by 42 mm thick ((excluding any stop).
  - The closer shall be fitted with intumescent protection in the form of a minimum of:
    - 2 mm thickness of mono ammonium phosphate sheet material, fully lining the mortices cut into the top edge of the door leaf to accommodate the closer body assembly and fully lining the mortices cut into the frame head member to accommodate the guide channel assembly (as above).
    - Allegion (UK) Ltd provides an intumescent protection kit referenced 2420.IP.
  - In addition the perimeter intumescent fire seals within the frame shall by-pass the guide rail and the intumescent protection by a minimum of 9 mm on each side.

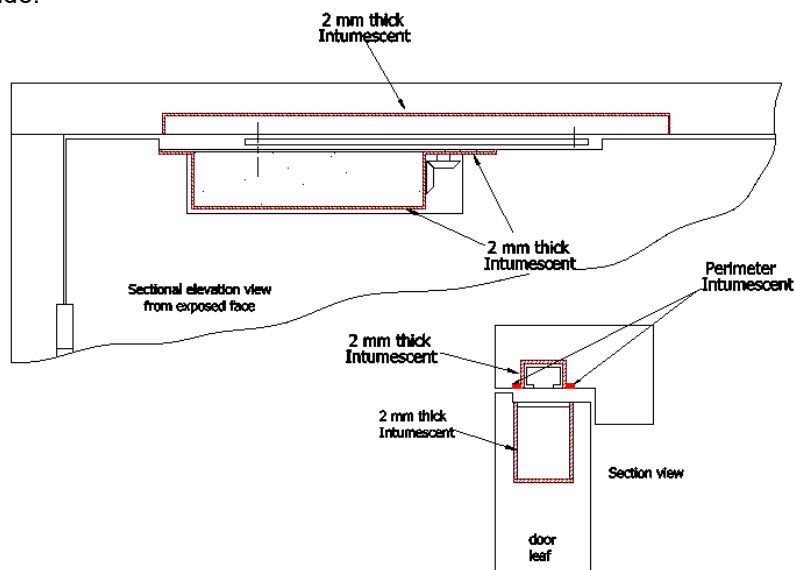


*Note: Failure to install intumescent protection identified above will invalidate this certificate*

11. This approval relates to Briton 2420.T.EHO & BOSS ITS6.24 with ITS6.24SA-EMF EHO guiderail and arm concealed overhead closers used with latched or unlatched single-leaf or double-leaf, assemblies consisting of timber faced and edged leaves with timber, cellulosic cores in timber frames (30 and 60 minutes) and:


## CERTIFICATE No CF 5292 ALLEGION (UK) LIMITED

- a. The bodies mounted in the door leaf, are approved for up to 30 minute single-action doorsets of the following specification (Code ITT):
- Door leaves shall not be less than 44 mm thick.
  - The door frame shall consist of softwood or hardwood with a minimum density of 450 kg/m<sup>3</sup> and with a minimum thickness of 33 mm (excluding any stop).
  - The closer shall be fitted with intumescent protection in the form of a minimum of:
    - 2 mm thickness of Interdens mono ammonium phosphate sheet material, fully lining the mortices cut into the top edge of the door leaf to accommodate the closer body assembly and fully lining the mortices cut into the frame head member to accommodate the guide channel assembly.
    - Allegion (UK) Ltd provides an intumescent protection kit referenced 2420.IP.

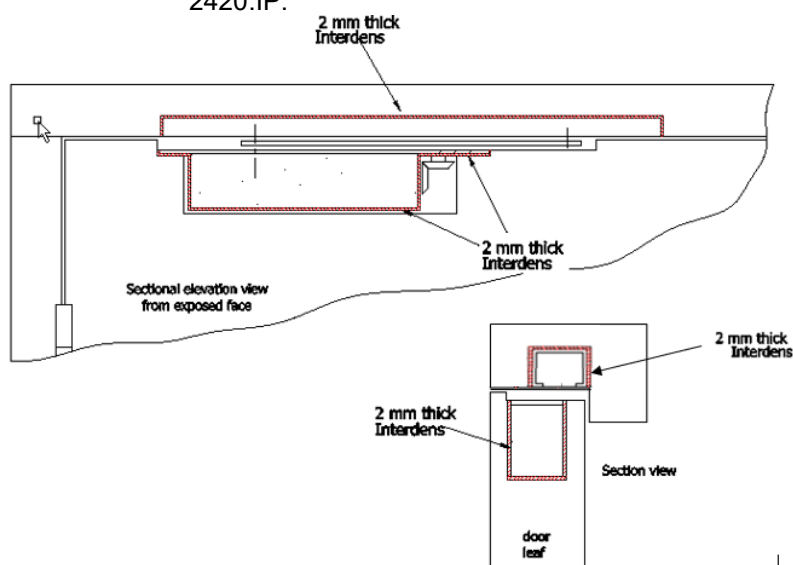

- b. The bodies mounted in the door leaf, are approved for 60 minute single-action doorsets of the following specification (Code ITT):
- Door leaves shall not be less than 54 mm thick.
  - The door frame shall consist of hardwood with a minimum density of 640 kg/m<sup>3</sup> and with a minimum thickness of 37 mm (excluding any stop).
  - The closer shall be fitted with intumescent protection in the form of a minimum of:
    - 2 mm thickness of mono ammonium phosphate sheet material, fully lining the mortices cut into the top edge of the door leaf to accommodate the closer body assembly and fully lining the mortices cut into the frame head member to accommodate the guide channel assembly.
    - Allegion (UK) Ltd provides an intumescent protection kit referenced 2420.IP.
  - In addition the perimeter intumescent fire seals within the frame shall by-pass the guide rail by a minimum of 9 mm on the opening face.

## CERTIFICATE No CF 5292 ALLEGION (UK) LIMITED

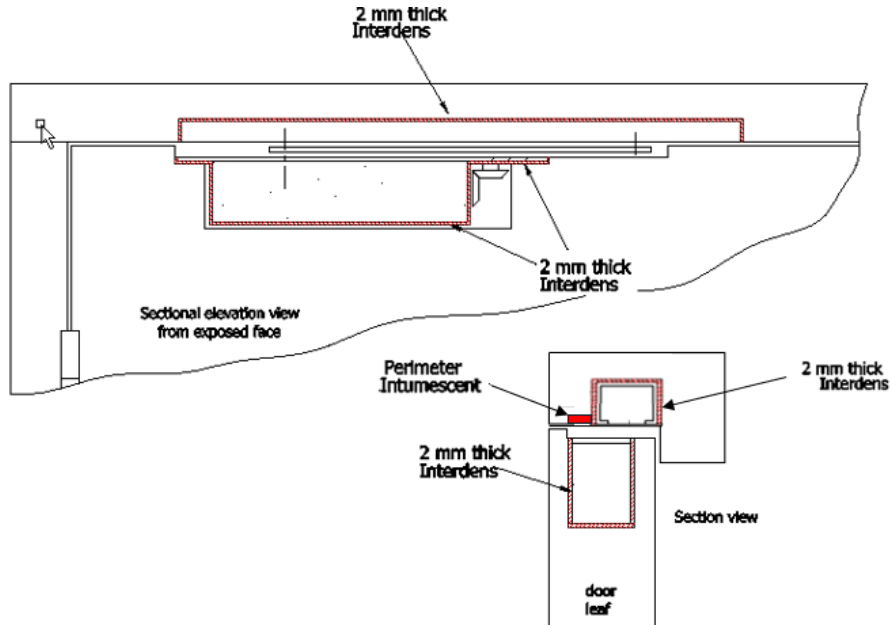

12. Closers in ITT doorsets shall be fixed with screws supplied by the closer manufacturer.
13. All door hardware is subject to the acceptance by the chosen door assembly supplier's tested, assessed, or certificated scope, which generally identifies the types of hardware approved, the required specification/design based on the key materials/ maximum size (e.g. body, face plate, guiderail, etc.), and the application of any additional intumescent protection.  
  
On this basis, approval should be sought from the specific door assembly supplier to ensure compliance based on this assessed/certificated scope.
14. ITT30 and 60 timber doorsets shall be installed in accordance with BS 8214.
15. The approval relates to on-going production. The product and/or its immediate packaging are identified with the manufacturer's name, the product name or number, the CERTIFIRE name or name and mark, together with the CERTIFIRE certificate number and application where appropriate.

## CERTIFICATE No CF 5292 ALLEGION (UK) LIMITED

16. The following tables show acceptable doorset types and fire resistance periods for Briton 2420.T and BOSS ITS6.24 (excluding the TS6.24SA-EMF Electro Hold Open track) closers only:

Class	Approved Door Type			
	IMM	MM	ITT	ITM
<b>BS476-22</b>				
FD20	x	x	✓	x
FD30	x	x	✓	x
FD60	x	x	✓	x
FD90	x	x	✓	x
FD120	x	x	x	x
FD240	x	x	x	x
<b>EN1634-1</b>				
<b>Integrity only</b>	<b>IMM</b>	<b>MM</b>	<b>ITT</b>	<b>ITM</b>
20	x	x	✓	x
30	x	x	✓	x
60	x	x	✓	x
90	x	x	✓	x
120	x	x	x	x
240	x	x	x	x
<b>Integrity/insulation</b>	<b>IMM</b>	<b>MM</b>	<b>ITT</b>	<b>ITM</b>
20	x	x	✓	x
30	x	x	✓	x
60	x	x	✓	x
90	x	x	✓	x
120	x	x	x	x
240	x	x	x	x

**Key:**

- ✓ - approved  
x - Not approved

## CERTIFICATE No CF 5292 ALLEGION (UK) LIMITED

17. The following tables show acceptable doorset types and fire resistance periods for Briton 2420.T.EHO and BOSS ITS6.24 where the TS6.24SA-EMF Electro Hold Open track is used:

Class	Approved Door Type			
	IMM	MM	ITT	ITM
<b>BS476-22</b>				
FD20	x	x	✓	x
FD30	x	x	✓	x
FD60	x	x	✓	x
FD90	x	x	x	x
FD120	x	x	x	x
FD240	x	x	x	x
<b>EN1634-1</b>				
<b>Integrity only</b>	<b>IMM</b>	<b>MM</b>	<b>ITT</b>	<b>ITM</b>
20	x	x	✓	x
30	x	x	✓	x
60	x	x	✓	x
90	x	x	x	x
120	x	x	x	x
240	x	x	x	x
<b>Integrity/insulation</b>	<b>IMM</b>	<b>MM</b>	<b>ITT</b>	<b>ITM</b>
20	x	x	✓	x
30	x	x	✓	x
60	x	x	✓	x
90	x	x	x	x
120	x	x	x	x
240	x	x	x	x

**Key:**

- ✓ - approved  
x - Not approved

## CERTIFICATE No CF 5292 ALLEGION (UK) LIMITED

18. Doors are categorised as the following types:

**Code ITT** - 20 minute to 120 minute door assemblies door assemblies incorporating intumescent perimeter seals and consisting of timber faced and edged leaves with timber or cellulosic cores, hung in timber or cellulosic frames.

**Code ITM** - 20 minute to 120 minute door assemblies door assemblies incorporating intumescent perimeter seals and consisting of timber faced and edged leaves with timber or cellulosic cores, hung in steel frames.

**Code MM** - 20 to 240 minute doorsets consisting of uninsulated or insulated predominantly steel leaves, hung in steel frames without intumescent seals.

**Code IMM** - 20 to 240 minute doorsets consisting of uninsulated or insulated predominantly steel leaves, hung in steel frames with intumescent seals.

### Scope of Approval:

- The closer may not be fitted to timber/mineral-based doorsets without perimeter intumescent fire seals within the frame rebate or door edge.
- The door leaves shall be of solid lignocellulosic or high density mineral construction in the closer area encompassing the entire closer body.
- Concealed overhead closers and their guide channel shall only be fitted in conjunction with the intumescent protection detailed previously in this certificate.
- Concealed overhead closers shall only be fitted to doorsets which have previously been shown capable of accommodating the installation of similar concealed items at the head of the doorset, without detriment to the doorset's performance.
- Mechanical Hold open option is not approved
- The following specific guide channel is approved for use with the concealed closers:
  - 440 mm x 23 mm wide x 15 mm deep guiderail with lever arm.
  - 527 mm x 31 mm wide x 30 mm deep EHO guiderail with lever arm (ITT30 and 60 only).
- The following EN1154 functions are supported by this certification:

Closer Ref.	Latch Control	Backcheck	Delayed-Action
Briton 2420.T	✓	x	x
BOSS ITS6.24	✓	x	x
Briton 2420.T.EHO	✓	x	x
BOSS ITS6.24SA-EMF	✓	x	x



---

## CERTIFICATE No CF 5292 ALLEGION (UK) LIMITED

---

### Classification codes:

This approval provides the following classifications for the closers in accordance with EN 1154:

Briton 2420.T & BOSS ITS6.24 - Standard door mount application only:

3	8	4 2	1	1	3
---	---	--------	---	---	---

This approval provides the following classifications for the closers in accordance with EN 1155:

Briton 2420.T.EHO and Boss ITS6.24 with TS6.24SA-EMF track - Standard door mount application only:

3	8	4 3	1	1	3
---	---	--------	---	---	---

*Note: power ratings shall be appropriate to the leaf sizes subject to a minimum size 3 (as specified in BS EN 1154).*

### Further Information

Further information regarding the details contained in this certificate may be obtained from Allegion (UK) Ltd (Tel: 0121 380 2400).

Further information regarding CERTIFIRE certification and other approved products can be obtained from CERTIFIRE (Tel: 01925 646777).